



CITY OF CAMBRIDGE
MASSACHUSETTS
Water Department
250 Fresh Pond Parkway
Cambridge, MA 02138
617 349 4770
fax 617 349 6616



November 2, 2009

OCTOBER, 2009 WATER SUPPLY SUMMARY REPORT

Highlights

- Reporting period 10/1/09-11/2/09
- Hobbs, Stony and Fresh Pond are currently at 70%, 96%, 96%* capacity respectively. (*Based on total reservoir storage, not gross usable capacity)
- Measured October precipitation (5.3") is 1.6 " greater than Massachusetts NE region October normals (3.7").

Storage

Figure 1: Hobbs Brook Reservoir Storage, October 2009

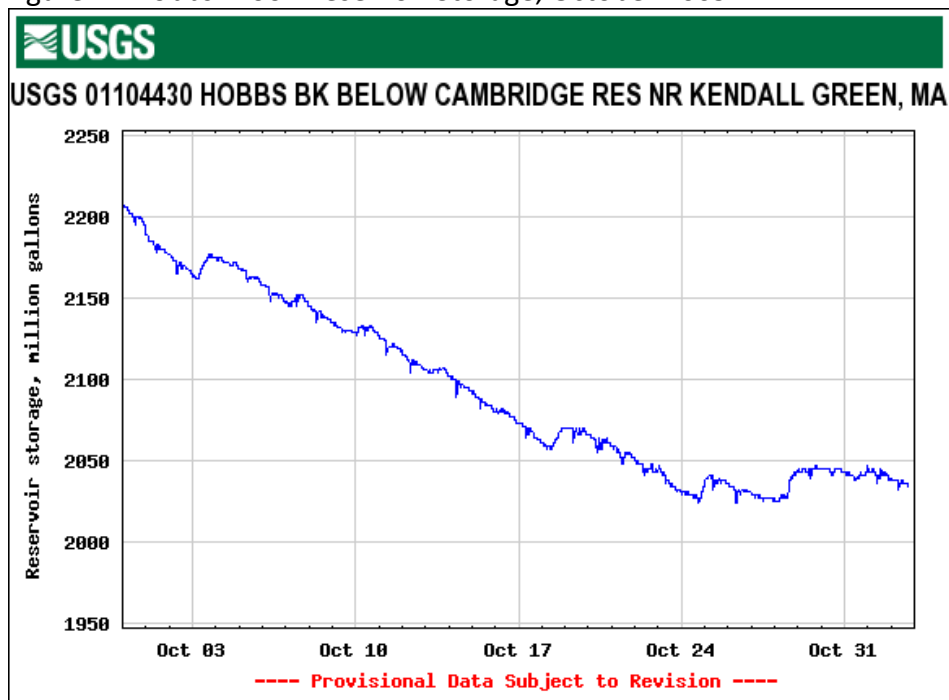


Figure 2. Stony Brook Reservoir Storage, October 2009



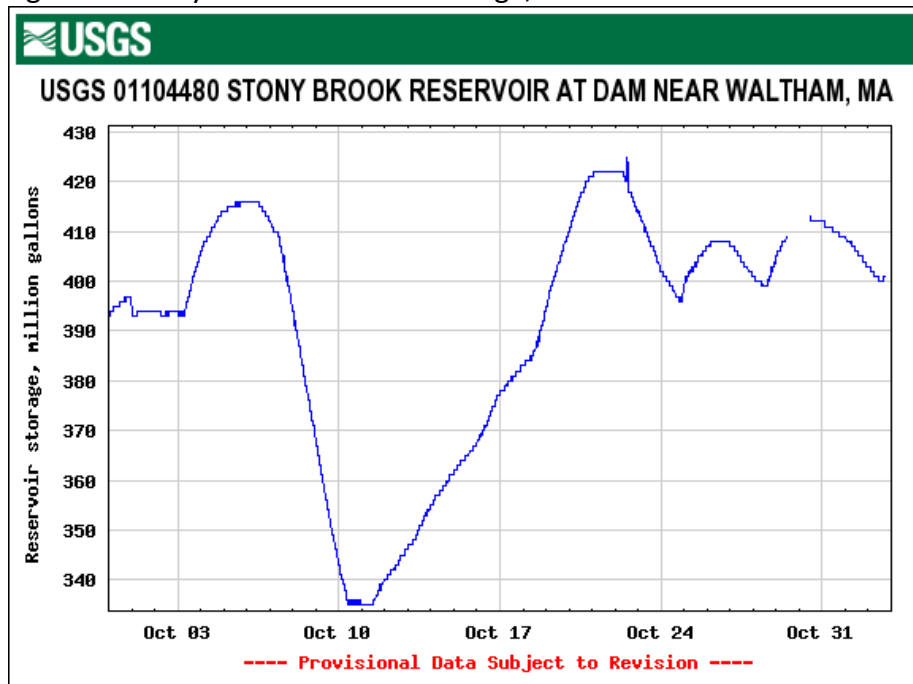


Figure 3. Fresh Pond Reservoir Storage, October 2009

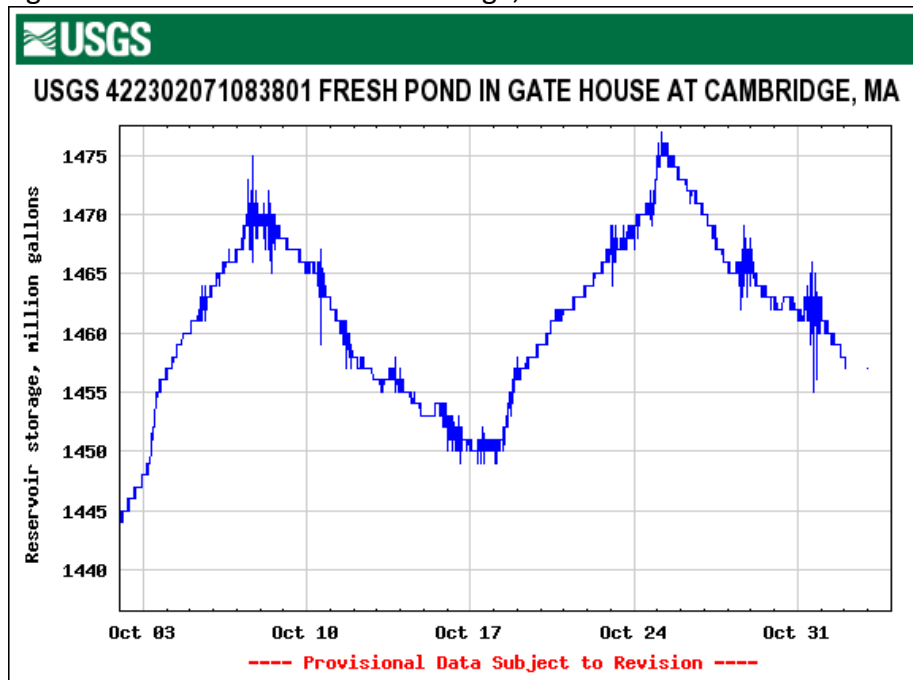

Precipitation

Figure 4. Rainfall at Hobbs Brook Reservoir, October 2009

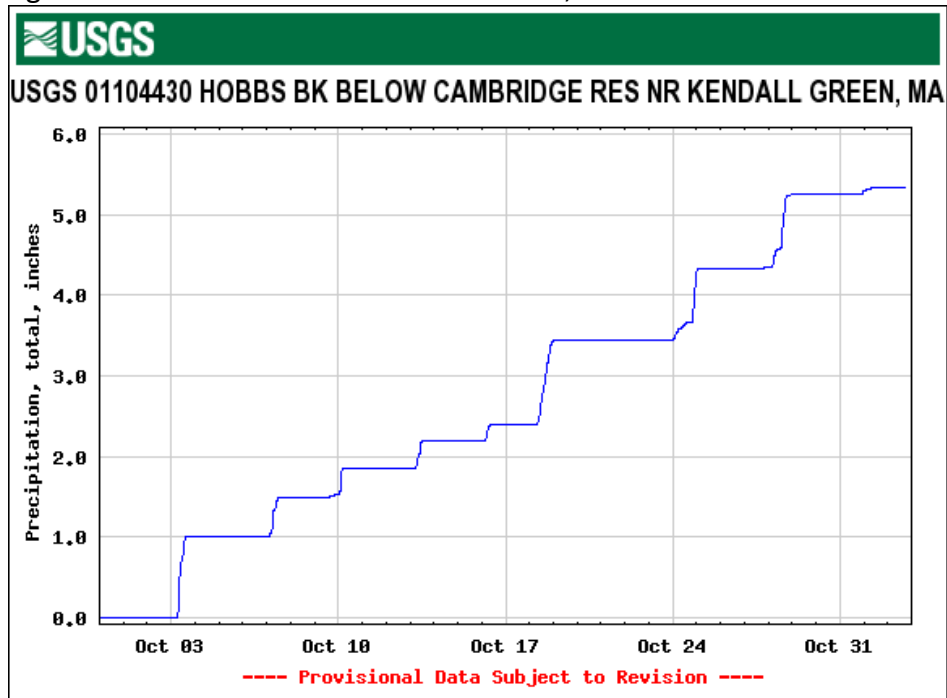

David Kaplan, Watershed Protection Supervisor

dkaplan@cambridgema.gov

617-349-4799

Real-time data available on the web at

http://waterdata.usgs.gov/ma/nwis/current?type=cambrid&group_key=NONE&search_site_no_station_nm=&format=html_table